


NOTE:

1. CONNECTION TO MAIN LINE AND FIRST AUXILIARY VALVE SHALL BE FLANGED.
2. FOR HYDRANT LATERAL LENGTHS OVER 6 L.F. INSTALL AN ADDITIONAL 6" FLG X MJ GATE VALVE AT THE HYDRANT
3. PIPE BEDDING SHALL COMPLY WITH SANDY CITY STANDARDS SPECIFICATIONS
4. ALL BOLTS, NUTS, AND T-BOLTS SHALL BE LUBRICATED WITH FML GREASE.

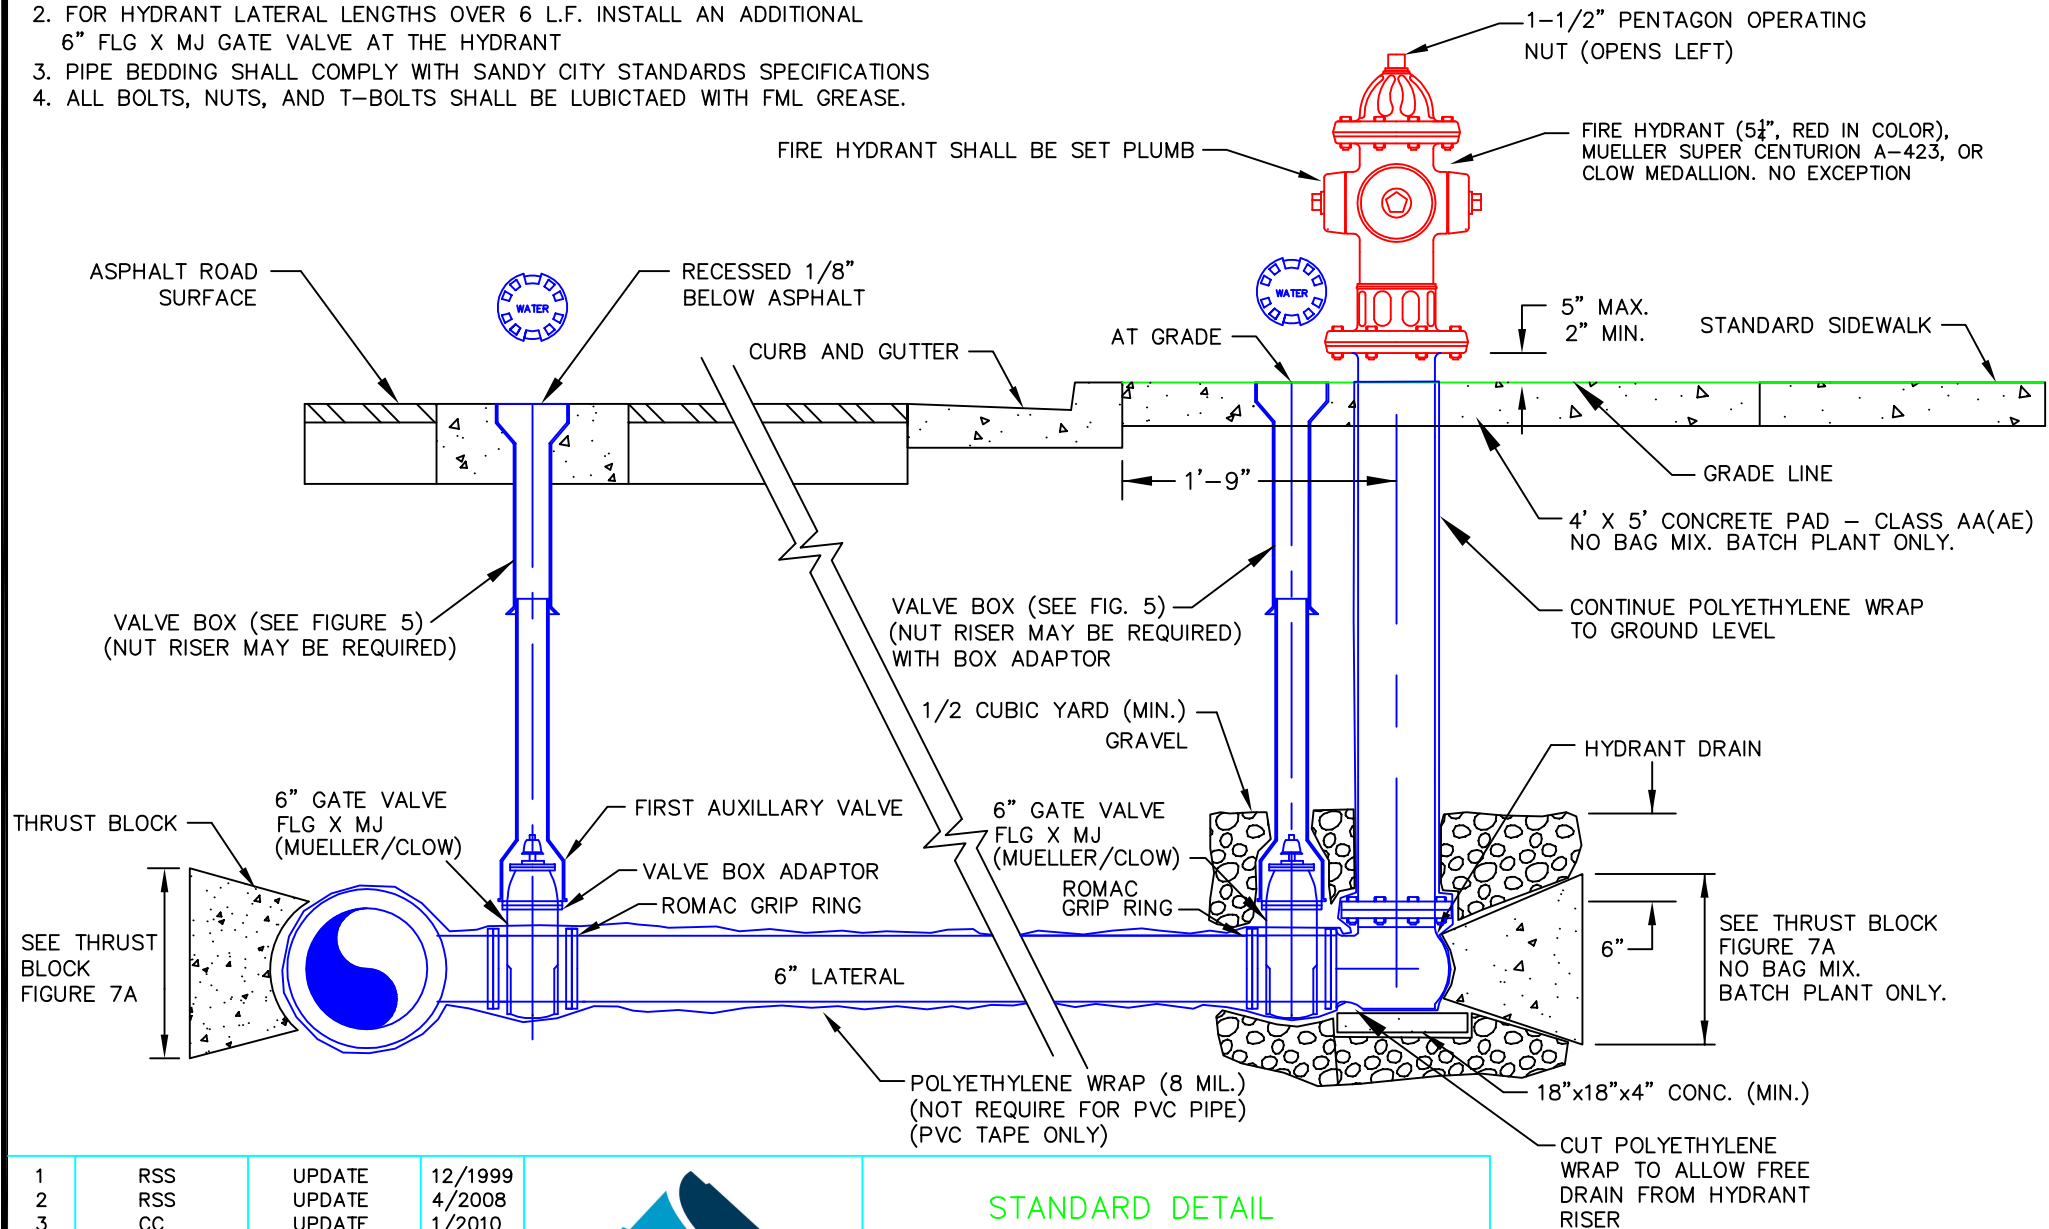

STANDARD DETAIL
FIGURE 02
FIRE HYDRANT CONNECTION

SCALE: NONE

| | | | |
|---|-----|--------|---------|
| 1 | RSS | UPDATE | 12/1999 |
| 2 | RSS | UPDATE | 4/2008 |
| 3 | CC | UPDATE | 1/2010 |
| 4 | CC | UPDATE | 5/2013 |
| 5 | CC | UPDATE | 3/2015 |
| 6 | CC | UPDATE | 2/2016 |



| NO. | AUTHORIZED BY | REVISIONS | DATE |
|-----|---------------|-----------|------|
|-----|---------------|-----------|------|